



Government of West Bengal
Office of the Deputy Superintending Engineer (HQ)
Public Health Engineering Directorate,
Jana Swasthya Karigari Bhawan (NIJALAYA), 4th Floor, Room No. 416
CN 8, Street No.18, CN Block, Bidhannagar, Kolkata-700091

Name of the Company **M/S. Dey's Medical Stores Pvt. Ltd.,**
Minerva Garden Complex, Diamond Harbour Road, Joka, Dist.- 24Pgs(S)

Ref. No. J/001/23-24

Date : 20.07.2023

In reference to the letter as cited above, the Inspection was made on 03.08.2023 in presence of the representative of the Unit and noted the following, which may please be recorded.

1.	The Desludging of the existing Septic Tank	:	Done : 1 No.
2.	Mode of disposal of sludge	:	In trenched pit within factory compound.
3.	Cleaning of existing Soak Pit /Chlorination Unit	:	1 No. Chlorination Chamber connected with Soak Pit.
4.	Soak Pit/ Chlorination Unit	:	To be maintained properly.
5.	a)Condition of lavatory Block b)White washing/Colour washing (As per Rule 42 of West Bengal Factory rules periodical white-washing/colour-washing of the Lavatory Block should be done at least once in every period of four months and the dates should be entered in the Register Form No.(6)	:	To be maintained properly & Unhygienic situation should be avoided near the sanitation unit. Done
6.	a) Place of drinking water	:	To be maintained properly. Tube-Well platform to be maintained properly.
	b) Surface Drains	:	To be attended regularly as routine programme
	c) Urinals	:	To be maintained properly.
	d)Water Closets	:	To be maintained properly.
7.	Annual Return for the year	:	Submitted as per prescribed format – 2023
8.	Next date of desludging will be on or before	:	July-2024
9.	Drinking Water :	:	
	a)Name of source/Tube well/Corporation supply	:	Purchase water [Water charges receipt copy submitted].
	b)Depth of Tube well as per declaration	:	[Declaration submitted].
	c) As per report dt. 04.07.2023 Submitted reveals the various parameters are within the acceptable limit.	:	Yes
	d) Next date of drinking water test.	:	03.01.2024 & 02.07.2024
	e) Whether storage tanks/cleaned regularly and maintained register.	:	It is advised to maintained register as mentioned.
	f) Details of the equipment installed.	:	Yes.
10.	Water & Effluent Test Report Submitted from WBPCB approved Laboratory/PHED Laboratory. a) Report submitted for	:	Yes Drinking Water


PTO

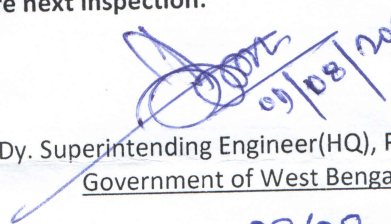
N.B. In case of any of drawing (showing the Site situation Plan and Section) should be submitted for the DY. Superintending Engineer (HQ), PHE Dte. For getting approval of Design. Site Situation Plan and Section etc. As per Rule 37(i) of West Bengal Factories Rule – 1958 (amended).
For provision for drinking water in the factory proposed construction for Septic Tank. Chlorination Unit, Soak Pit, Secondary Treatment Plant, Filter Bed etc. 04(four) sets rule (34) & rule (35) of West Bengal Factories Rule, 1958(as amended) should be followed.

OBSERVATIONS:

1. All Vent Pipe with M.P. Netted Cowl to be checked time to time to avoid danger in future.
2. All Sanitary arrangement to be kept clean & maintained hygienic all time with spreading of bleaching powder regularly.
3. Septic Tank with Secondary treatment unit to be provide as per IS 2470 Part I & II – 1985 as mentioned.[i.e. vent pipe , manhole, freeboard & open to sky(Clause No.3.3.1) should be provide as mentioned]. Under no circumstances should effluent from Septic tank be allowed into an open channel drain or body of water without adequate treatment [Clause 3.3.3. IS2470(Part-I) 1985].
4. Next desludging should be done as per Sl. No. 8 of this I.R. as per Factory Rules.
5. Surface drain should not be water logged, stagnant water should be avoided.
6. Useful arrangement should be done for the time of Pandemic situation to avoid Covid – 19.
7. Tube Well to be maintained properly. [Necessary documents regarding Tube Well should be submitted properly as early as possible].
8. All Pit covers to be operated and mentioned at the time of maintenance work & for Inspection.

Please take necessary action from your end before next Inspection.


Junior Engineer(HQ), PHE Dte.

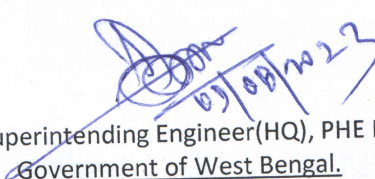

Dy. Superintending Engineer(HQ), PHE Dte.
Government of West Bengal.

Memo. No. 338-(1-3)/ST/DSE(HQ) Dated, Kolkata, the 09/08/2023.

Copy forwarded for information and necessary action to :

1. The Chief Inspector of Factories, Dte. of Factories, N.S. Bldgs.(8th Floor),Kolkata-700 001.
Necessary **clearance certificate** to be issued after compliance of the observations stated above.
2. The West Bengal Pollution Control Board, Paribesh Bhawan, Block-L, Sector-III, Salt Lake, Kolkata – 700 098.
3. The Junior Engineer, P.H.E. Dte.(HQ).

08.08.23tk


Dy. Superintending Engineer(HQ), PHE Dte.
Government of West Bengal.

